Lightning Surge Protectors for Electronics Equipment M-RESTER


LIGHTNING SURGE PROTECTOR FOR THERMOCOUPLE USE

(ultra-slim)

Functions & Features

+ High discharge current capacity 20 kA (8 / 20 $\mu s),$ 1 kA (10 / 350 $\mu s)$

- Ultra-thin 7-mm-wide module can be mounted
- in high density
- Excellent protection employing multi-stage SPD circuits
- DIN rail mounting and grounding
- Shield terminal provided
- CE marking



MODEL: MD7TC-[1][2]

ORDERING INFORMATION

• Code number: MD7TC-[1][2] Specify a code from below for each [1] and [2]. (e.g. MD7TC-FF0) For the safety approval code 2, specify the product's destination country using Ordering Information Sheet (No. ESU-8057).

幸託有限公司

XIN TOP CORPORATION

[1] SHIELD TERMINAL (line / earth)

FF: Floating / Floating FG: Floating / Grounding GF: Grounding / Floating GG: Grounding / Grounding

[2] SAFETY APPROVAL

0: None 2: CENELEC intrinsic safety (ATEX)

GENERAL SPECIFICATIONS

Construction: Slim-sized front terminal structure Degree of protection: IP20 Connection: Euro terminal block (torque 0.3 N·m) Applicable wire size: 0.2 – 2.5 mm² Grounding: DIN Rail Housing material: Flame-resistant resin (black)

INSTALLATION

Operating temperature: -25 to +85°C (-13 to +185°F) (See Safety Parameters for use in a hazardous location.) Operating humidity: 30 to 90 %RH (non-condensing) Mounting: DIN Rail (TH35-7.5, 1-mm-thick) Oxide film on the surface of an aluminium rail may lower the electric conductivity between this module and the ground. Use a steel or copper rail. Weight: 70 g (2.5 oz)



 TEL : (02)2598-1199
 E-mail : info@xintop.com

 FAX : (02)2596-2331
 Website : www.xintop.com

PERFORMANCE

MODEL NO.		MD7TC-FF	MD7TC-FG	MD7TC-GF	MD7TC-GG
continuous operating voltage (Uc)	Line to Line	7.5V			
	Line to Earth	±160V		±7.5V	
	Line to SHLD	±160V ±		.5V	
	SHLD to Earth	±160V	short	±160V	short
Voltage protection level (Up)	Line to Line	25V			
@4kV (1.2 / 50 µs)	Line to Earth	±800V			±25V
	Line to SHLD	±1200V	±800V	±25V	
	SHLD to Earth	±800V	short	±800V	short
Leakage current @Uc	Line to Line	≤5µA			
	Other sections	≤5µA			
Response time	Line to Line	≤4 nsec.			
	Other sections	≤20 nsec.			
discharge current (Imax)		20kA (8 / 20 µs), 1.0kA (10 / 350 µs)			
Nominal current (I _N)		100mA			
Internal series resistance		$4.7\Omega \pm 10\%$ per line			

STANDARDS & APPROVALS

CE conformity:

ATEX Directive (94/9/EC) Ex ia EN 60079-11: 2007 Category 1G EN 60079-26: 2007 EMC Directive (2004/108/EC) EMI EN 61000-6-4: 2007 EMS EN 61000-6-2: 2005

Safety approval:

CENELEC: Intrinsic safety (ATEX) 🐵 II 1G, Ex ia IIC; T4 and T5 EN 60079-0: 2006 EN 60079-11: 2007 EN 60079-26: 2007

Surge protection: IEC 61643-21: 2000

(Categories C1, C2, D1)

SAFETY PARAMETERS

■ CENELEC / ATEX IS DATA

Ui (Vmax)	16V				
li (Imax)	any				
Ci	35 nF				
Li	0 µH				
Pi	Temp. Class	Range	Parameter		
	T4	-25 to +40°C	1.3W		
		-25 to +60°C	1.2W		
		-25 to +80°C	1.0W		
	T5	-25 to +40°C	1.0W		

幸託有限公司

XIN TOP CORPORATION



FAX : (02)2596-2331

TEL: (02)2598-1199 E-mail: info@xintop.com Website : www.xintop.com

DESCRIPTIONS


■ SELECTING SHIELD TERMINAL TYPE

- The surge protector has a dedicated shield terminal effective for easy shield wiring and surge protection.
- Review the shield method (grounding, non-grounding, connecting to SG, etc.) required by the protected device or system.


There is no electrical effect to the shield by installing the surge protector, but an appropriate shield terminal type must be

selected to suit user applications.

· Refer to the flow chart below to choose.

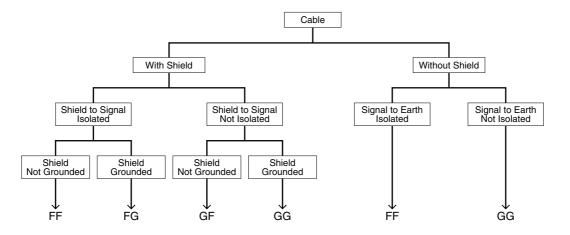

CONNECTION EXAMPLES

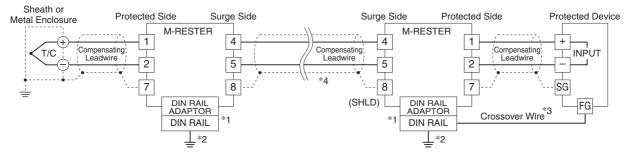

*1. Oxide film on the surface of an aluminium rail may lower the electric conductivity between this module and the ground. Use a steel or copper rail.

*2. Be sure to ground the DIN rail. Recommended grounding resistance $\leq 100\Omega$

幸託有限公司

XIN TOP CORPORATION

- *3. Cross-wire between the DIN rail and the metal housing of the protected device to equalize the earth potential.
- Ground only the surge protector when the protected device has no ground terminal.


*4. Shield wiring method is an example. Proceed according to the system requirements.



FAX : (02)2596-2331

TEL: (02)2598-1199 E-mail: info@xintop.com Website : www.xintop.com

EXTERNAL DIMENSIONS & TERMINAL ASSIGNMENTS unit: mm (inch)

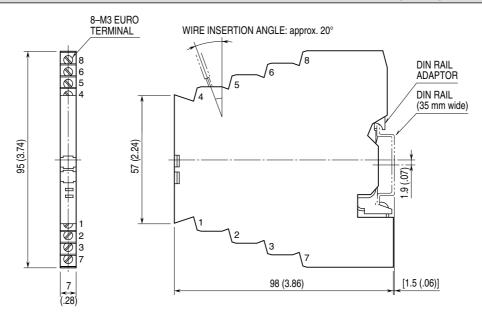




幸託有限公司 TEL: (02)2598-1199 E-mail: info@xintop.com FAX : (02)2596-2331 XIN TOP CORPORATION

Website : www.xintop.com

SCHEMATIC CIRCUITRY

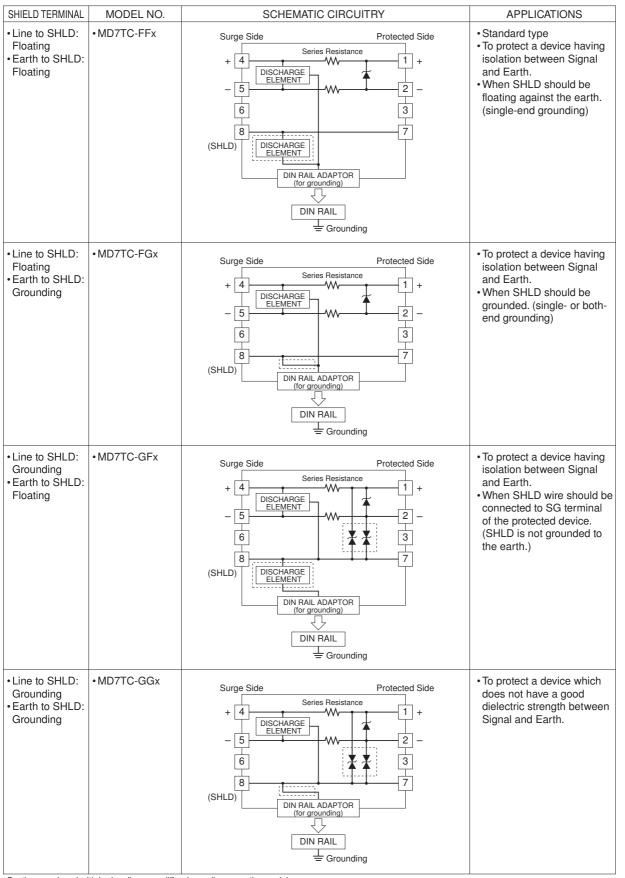

Sections enclosed with broken line may differ depending upon the models

幸託有限公司

XIN TOP CORPORATION



TEL: (02)2598-1199 E-mail: info@xintop.com FAX: (02)2596-2331 Website: www.xintop.com Specifications are subject to change without notice.





FAX : (02)2596-2331

TEL: (02)2598-1199 E-mail: info@xintop.com Website : www.xintop.com