


Remote I/O R3 Series

DC CURRENT INPUT ALARM MODULE

(8 points, isolated)

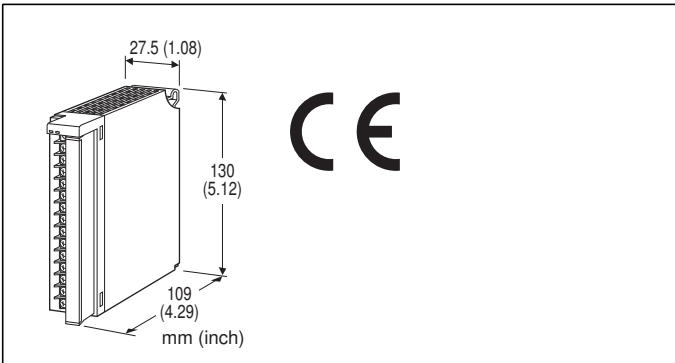

MODEL: R3-AS8[1][2]

ORDERING INFORMATION

- Code number: R3-AS8[1][2]
Specify a code from below for each [1] and [2].
(e.g. R3-AS8W/CE/Q)
- Specify the specification for option code /Q
(e.g. /C01)

NO. OF CHANNELS

8: 8

[1] COMMUNICATION MODE

S: Single
W: Dual

[2] OPTIONS (multiple selections)

Standards & Approvals

blank: Without CE
/CE: CE marking

Other Options

blank: none
/Q: Option other than the above (specify the specification)

SPECIFICATIONS OF OPTION: Q

COATING (For the detail, refer to M-System's web site.)

/C01: Silicone coating
/C02: Polyurethane coating
/C03: Rubber coating

CAUTION

■UNUSED INPUT CHANNELS

Set the unused input channels to ± 20 mA or 0 - 20 mA

range. Unused channels left open with 4 - 20 mA setting are equal to the input lower than -15 %, which sets a data abnormality at the PLC or the host device.

Open circuit with the input range set to ± 20 mA means 50 % of the full-scale. An alarm setpoint must be set to a value that does not trip an unwanted alarm.

Unused channels can be specified and set so on the PC Configurator Software (model: R3CON) without needing the above mentioned setting.

GENERAL SPECIFICATIONS

Connection

Internal bus: Via the Installation Base (model: R3-BSx)

Input: M3 separable screw terminal (torque 0.5 N·m)

Internal power: Via the Installation Base (model: R3-BSx)

Screw terminal: Nickel-plated steel

Isolation: Input 1 to input 2 to input 3 to input 4 to input 5 to input 6 to input 7 to input 8 to internal bus or internal power

Input range: Selectable with the side DIP SW (per 4 channels)

Conversion rate: Selectable with the side DIP SW

RUN indicator: Bi-color (red/green) LED;
Red when the bus A operates normally;
Green when the bus B operates normally;
Amber when both buses operate normally.

ERR indicator: Bi-color (red/green) LED;
Red with the input circuit abnormality (AD converter response failure);
Green in normal operating conditions.

INPUT SPECIFICATIONS

■ **DC Current:** -20 - +20 mA, 0 - 20 mA, 4 - 20 mA DC
Input resistance: 66.5 Ω resistor incorporated

INSTALLATION

Operating temperature: -10 to +55°C (14 to 131°F)
Operating humidity: 30 to 90 %RH (non-condensing)
Atmosphere: No corrosive gas or heavy dust
Mounting: Installation Base (model: R3-BSx)
Weight: 250 g (0.55 lb)

PERFORMANCE

Conversion accuracy: Refer to the table at the end of this section.
Conversion rate: 160 / 80 / 40 / 20 msec. selectable
Data range: 0 - 10000 of the input range
Data allocation: 4
Current consumption: 100 mA
Temp. coefficient: ± 0.03 %/°C (± 0.02 %/°F)
Insulation resistance: ≥ 100 M Ω with 500 V DC



Dielectric strength: 1000 V AC @ 1 minute (input 1 to input 2 to input 3 to input 4 to input 5 to input 6 to input 7 to input 8 to internal bus or internal power)
 2000 V AC @ 1 minute (power input to FG; isolated on the power supply module)

RANGE \ RATE	160 msec.	80 msec.	40 msec.	20 msec.
-20 – +20 mA	±0.05%	±0.1%	±0.2%	±0.4%
0 – 20 mA	±0.1%	±0.2%	±0.4%	±0.8%
4 – 20 mA	±0.1%	±0.2%	±0.4%	±0.8%

STANDARDS & APPROVALS

CE conformity:
 EMC Directive (2004/108/EC)
 EMI EN 61000-6-4: 2007/A1: 2011
 EMS EN 61000-6-2: 2005

ALARM SETTING

The following parameters are programmable using the PC Configurator Software (model: R3CON).


- **ALARM TRIP POINT** (-15.00 to +115.00 %)
 Four alarm setpoints are selectable per each input.
- **ALARM TYPE (High or Low)**
 High or Low alarm is selectable for each alarm trip point.
High alarm: An alarm is set when the input signal goes above the setpoint.
Low alarm: An alarm is set when the input signal goes below the setpoint.
- **DEADBAND (HYSTERESIS)**
 (0.00 to 100.00 %; factory set to 5.00)
 Deadband (deviation between the points where the alarm is set and reset) is selectable for each alarm trip point.
- **ALARM ON DELAY TIME**
 (0.0 to 99.0 seconds; factory set to 1.0)
 The alarm output is set when the preset time elapses after the input has entered in the alarm range.
 This setting is common to all 8 points.
- **POWER ON DELAY TIME**
 (0.0 to 99.0 seconds; factory set to 5.0)
 The alarm output start functioning in the preset time after the power has been turned on.
 This setting is common to all 8 points.
- **ALARM HOLD TIME**
 (0.0 to 99.0 seconds; factory set to 1.0)
 The alarm output is held for the preset time even if it is reset in shorter time.
 This setting is common to all 8 points.



EXTERNAL VIEW


SIDE VIEW

FRONT VIEW

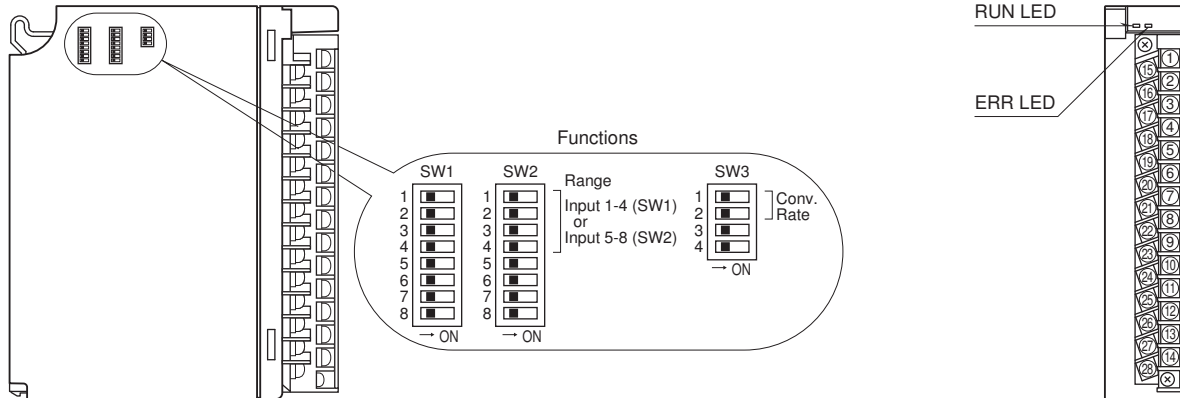


OUTPUT DATA DESCRIPTIONS


Four alarm setpoints are selectable per each input. Two (2) word (16 bits × 2) data is transmitted to the PLC or the host device via the R3 network module.

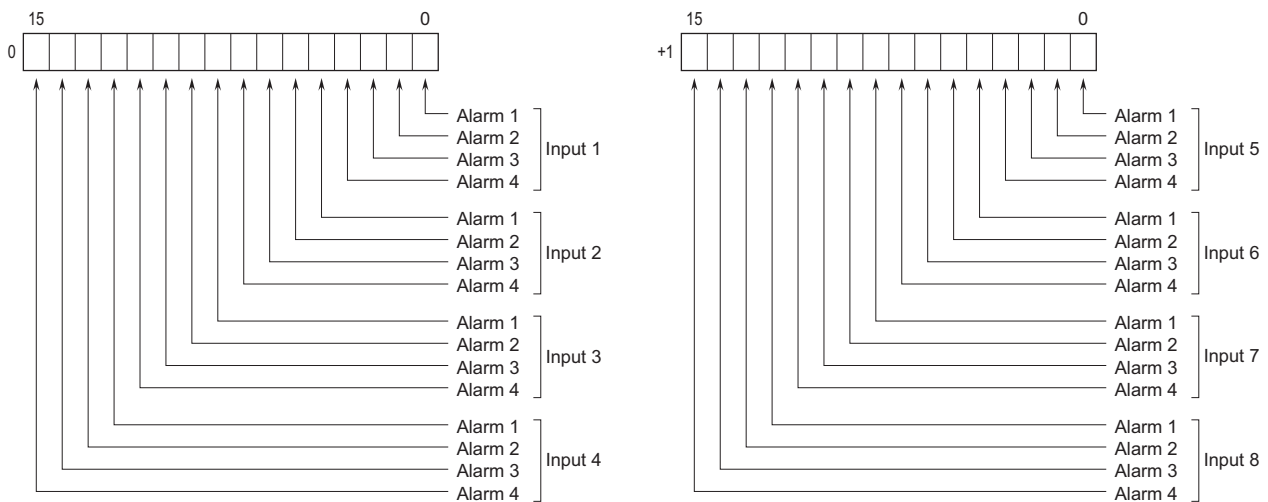

EXTERNAL DIMENSIONS & TERMINAL ASSIGNMENTS unit: mm (inch)

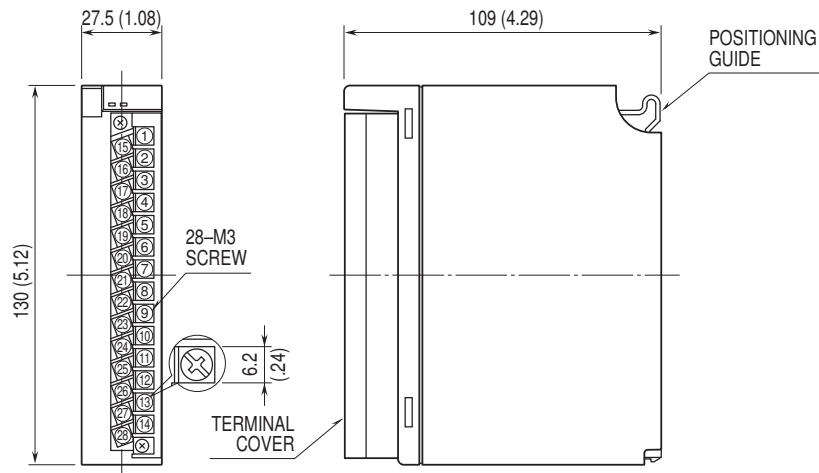

SCHEMATIC CIRCUITRY & CONNECTION DIAGRAM

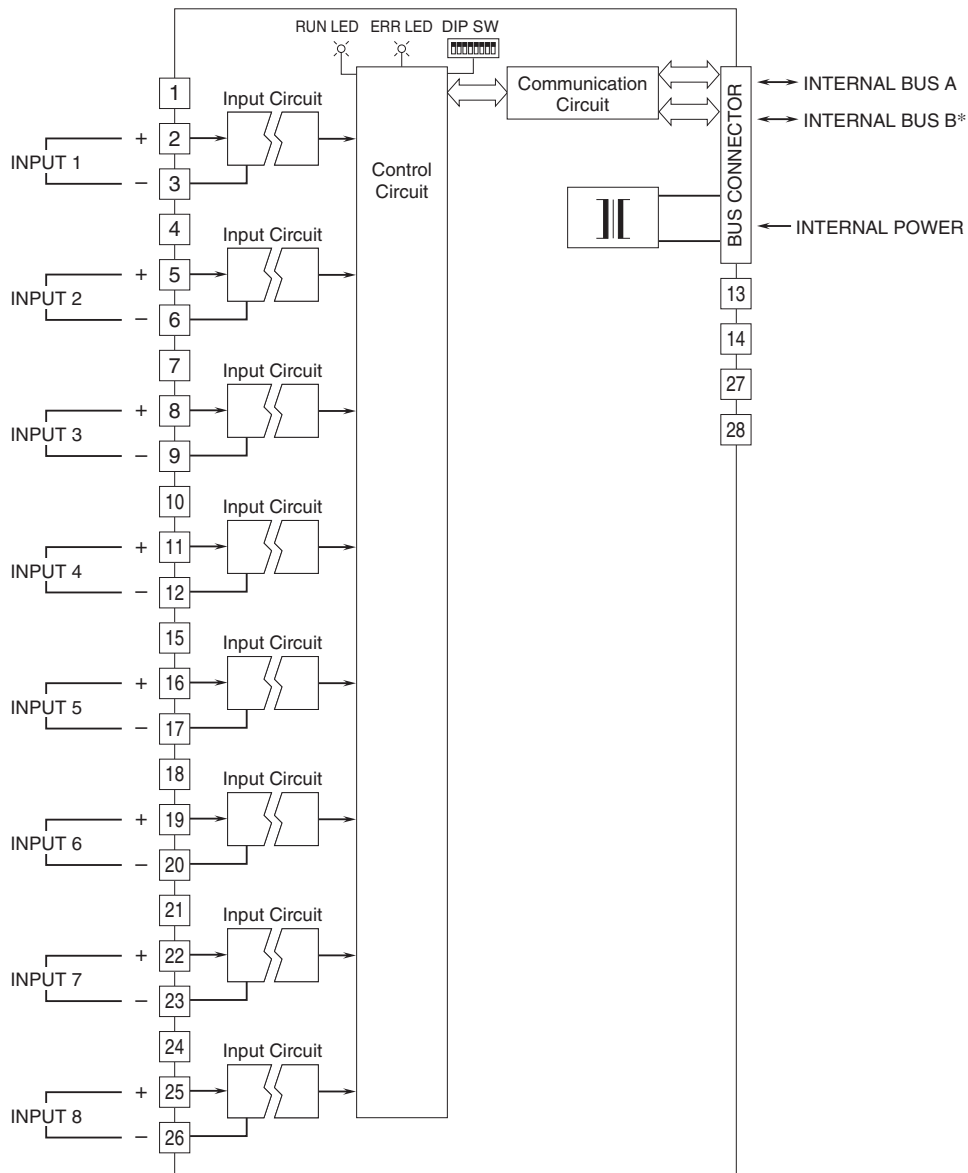

*For dual redundant communication.



Specifications are subject to change without notice.

