


Remote I/O R3 Series

/C03: Rubber coating

TOTALIZED PULSE INPUT MODULE

(Pi 8 points, 32 Bits)

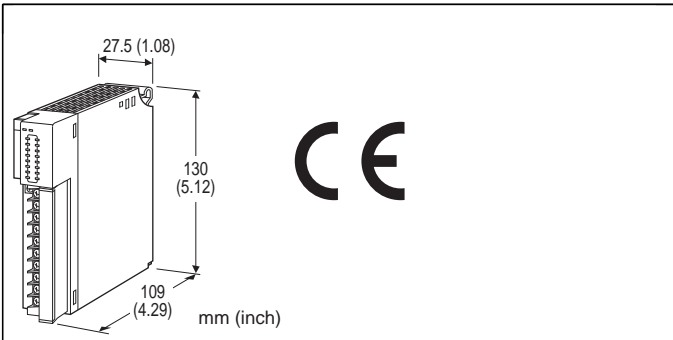

MODEL: R3-PA8[1][2]

ORDERING INFORMATION

- Code number: R3-PA8[1][2]
Specify a code from below for each [1] and [2].
(e.g. R3-PA8W/A/CE/PRS/Q)
- Specify the specification for option code /Q
(e.g. /C01)

NO. OF CHANNELS

8: 8

[1] COMMUNICATION MODE

S: Single
W: Dual

[2] OPTIONS (multiple selections)

Excitation

Blank: Internal (negative common)
/A: External (24 V DC, negative common)

Standards & Approvals

blank: Without CE
/CE: CE marking

EX-FACTORY SETTING

blank: Enable count reset by host PC/PLC
/PRS: Enable count preset by host PC/PLC

Other Options

blank: none
/Q: Option other than the above (specify the specification)

SPECIFICATIONS OF OPTION: Q

COATING (For the detail, refer to M-System's web site.)

/C01: Silicone coating
/C02: Polyurethane coating

RELATED PRODUCTS

- Interface module (model: R3-NC1, -NC3, -NE1, -NM1, -NDx, -NFL1, -NFx. NF2: Firmware version V0.05 or later)

Note:

Count reset by host PC/PLC:

Available with this unit and the above mentioned interface modules of firmware version V2.00 or later, except R3-NFx. Notice that Count reset by host PC/PLC via R3-NFx or interface module of previous versions of firmware is unable.

Count preset by host PC/PLC:

It is only available in combination with this unit displayed 'SW3-4 RESET/PRESET' on the right side panel and the interface module R3-NM1 or R3-NE1 of firmware version V2.00 or later. Count preset is not available for other combination.

Notice that this function is not available in the same time as count preset by host PC/PLC.

In the FL-net Configuration Builder software (model: R3-NFLBLD), the number of channel for this module is displayed as 16 because data has 8 channels x 2 words.

GENERAL SPECIFICATIONS

Connection

Internal bus: Via the Installation Base (model: R3-BSx)

Input: M3 separable screw terminal (torque 0.5 N·m)

Internal power: Via the Installation Base (model: R3-BSx)

Screw terminal: Nickel-plated steel

Isolation: Input to internal bus or internal power

RUN indicator: Bi-color (red/green) LED;

Red when the bus A operates normally;

Green when the bus B operates normally;

Amber when both buses operate normally.

ERR indicator: Bi-color (red/green) LED;

Red with the input abnormality;

Green in normal operating conditions.

Input status indicator: Red LED;

1 to 8: Turns on with the inputs supplied.

9 to 15: Unused (The LEDs are connected with terminals via internal circuit. Therefore, the LED turns on, if the corresponding terminal is connected to terminal 10 or 20. However, it does not affect the operation.)

16: Turns on with the reset input supplied.

Count reset: Via DIP switch on the side or one pulse to reset input

Count setting by host PC/PLC: Count reset/count preset is changeable via DIP switch on the side.



INPUT SPECIFICATIONS

Number of input: 9 (8 points + Count reset)

Input resistance: 6 k Ω

Common: Negative commons, all points; 2 terminals

Maximum frequency: 100 Hz

(ON/OFF time \geq 5 msec.)

This unit is designed to be able to accept a frequency up to 100 Hz, however, 'chattering' contact must be avoided for accurate measuring of such high frequency. Use mercury relays or similar ones that do not cause any chattering.

Totalized pulse range: 0 - 9999999

Count at overflow: Reset and restart at '0.'

Max. pulse range selectable from 10000 to 2147483647 using the R3CON PC Configurator Software. '0' or '1' from which restart counting at overflow is pre-settable. Refer to the R3CON Users Manual for detailed information.

■ R3-PA8x (internal excitation)

Sensing voltage: 13 V DC (max. 24 V with no load)

ON voltage: \geq 9 V (\leq 1.5 k Ω)

OFF voltage: \leq 4.5 V (\geq 18 k Ω)

■ R3-PA8x/A (external excitation)

Sensing voltage: 24 V DC

ON voltage: \geq 9 V (\leq 12 k Ω)

OFF voltage: \leq 4.5 V (\geq 36 k Ω)

INSTALLATION

Operating temperature: -10 to +55 $^{\circ}$ C (14 to 131 $^{\circ}$ F)

Operating humidity: 30 to 90 %RH (non-condensing)

Atmosphere: No corrosive gas or heavy dust

Mounting: Installation Base (model: R3-BSx)

Weight: 200 g (0.44 lb)

PERFORMANCE

Data allocation: 16

Current consumption: 70 mA

Insulation resistance: \geq 100 M Ω with 500 V DC

Dielectric strength: 2000 V AC @ 1 minute

(input to internal bus or internal power)

2000 V AC @ 1 minute (power input to FG; isolated on the power supply module)

STANDARDS & APPROVALS

CE conformity:

EMC Directive (2004/108/EC)

EMI EN 61000-6-4: 2007/A1: 2011

EMS EN 61000-6-2: 2005

FUNCTIONS

■ MANUAL COUNT RESET

1) Remove Network Module or its cables and interrupt

communication with other devices.

2) Turn ON the Count Reset SW (DIP SW3-1) on R3-PA8 module.

3) Return the module to the base and turn the power supply on.

4) ERR LED turns on and the module starts resetting its counter. When the resetting is complete, the LED light turns to green. DO NOT remove the power while the red light is on.

5) After confirming that ERR LED is green, turn the power supply off.

6) Turn OFF the Count Reset SW (DIP SW3-1).

7) Return the Network module onto the base and turn the power supply on.

Note: Count Reset SW must be turned OFF after this procedure because the module does not start counting with ON state.

Even when the count overflow set value is 1, the counter is reset to 0.

■ REMOTE COUNT RESET INPUT

With the Count Reset Input SW (DIP SW3-3) turned ON, the count reset signal value becomes effective.

SW3-3 = OFF: unused

SW3-3 = ON: reset signal.

One pulse supplied at the Count reset input terminal will be recognized as a reset signal.

■ REMOTE COUNT RESET OPERATION

1) ERR LED turns on (red color) when the reset signal is received.

2) In 1 second, the module starts resetting its counter. When the resetting is complete, the LED light turns to green.

3) After 1 second, ERR LED turns back to the state before the reset signal has been received.


Note: Reset signals received while the module is processing (1) through (3) are ignored.

Even when the count overflow set value is 1, the counter is reset to 0.




EXTERNAL VIEW

FRONT VIEW

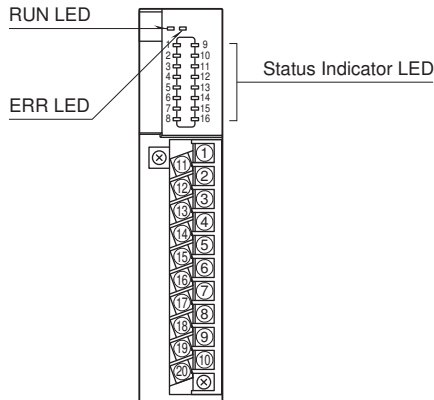

SIDE VIEW

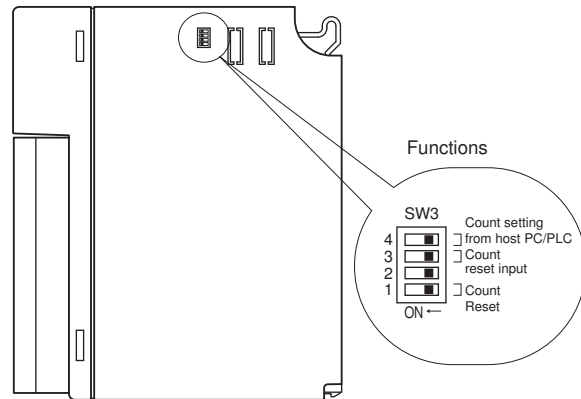

Set the Count Reset SW to OFF to start counting.

COUNTER SETTING FROM HOST PC/PLC

■ COUNTER RESET


(Available for R3-NC1, R3-NC3, R3-NE1, R3-NM1, R3-NDx, R3-NFL1 (Firmware version 2.00 or later))

Setting SW3-4 OFF and turning power on enable the function.

The bits indicating the channels to reset counter are allocated in the first word from host PC/PLC.

When these bits are changed from 0 to 1, the counter is reset. When it is confirmed that the counter is reset, return to 0.

Notice that if the bit remains at 1, the next reset will not work.

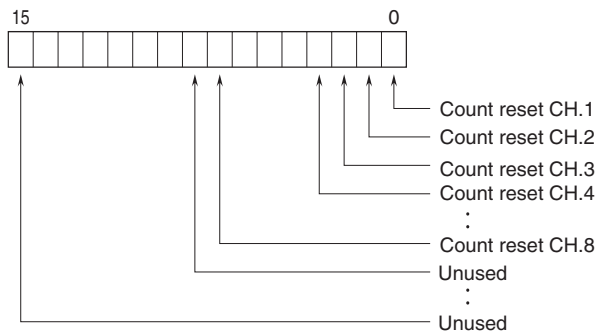

■ COUNTER PRESET



(Available in combination with R3-NE1, R3-NM1 (Firmware version 2.00 or later), and R3-PA8 displayed 'SW3-4 RESET/PRESET' on the right side)

Setting SW3-4 ON and turning power on enable the function.


Write the preset value to the Holding Register, which has same address as the Input Register.

• Input Registers

• Holding Registers

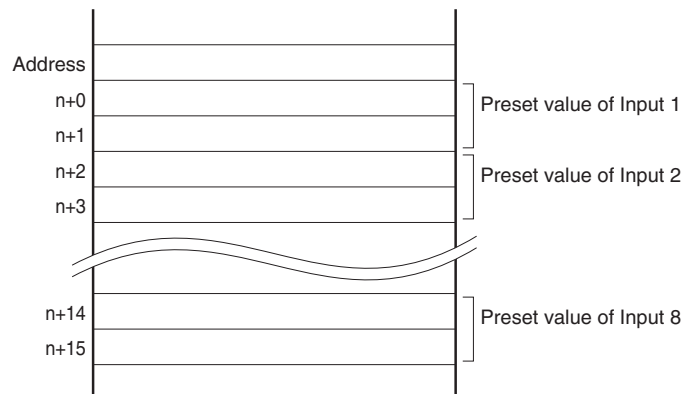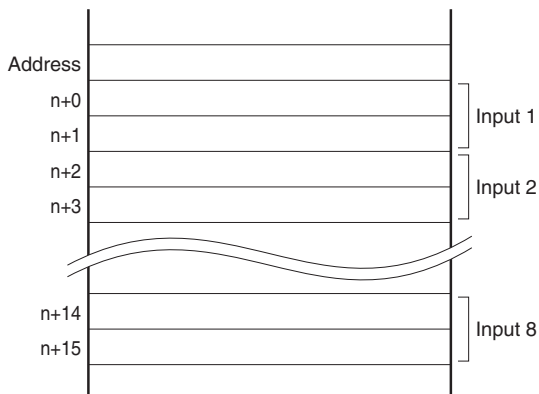


DIMENSIONS unit: mm (inch)

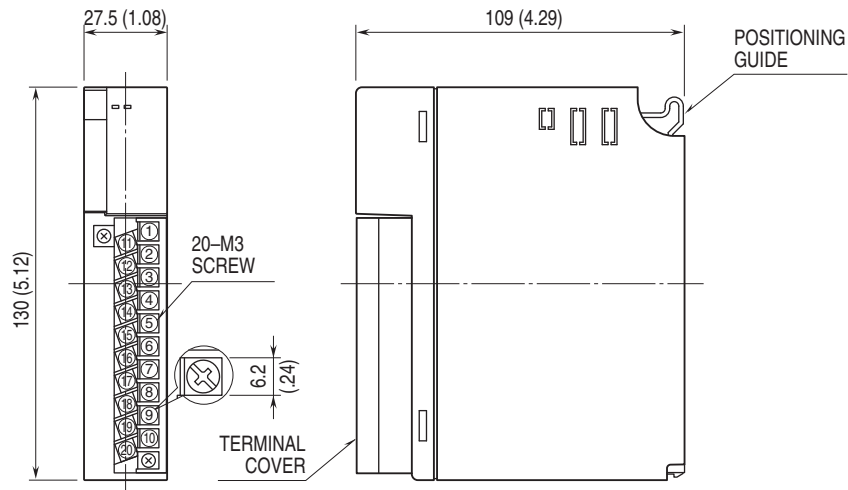


SCHEMATIC CIRCUITRY & CONNECTION DIAGRAM

■ R3-PA8x

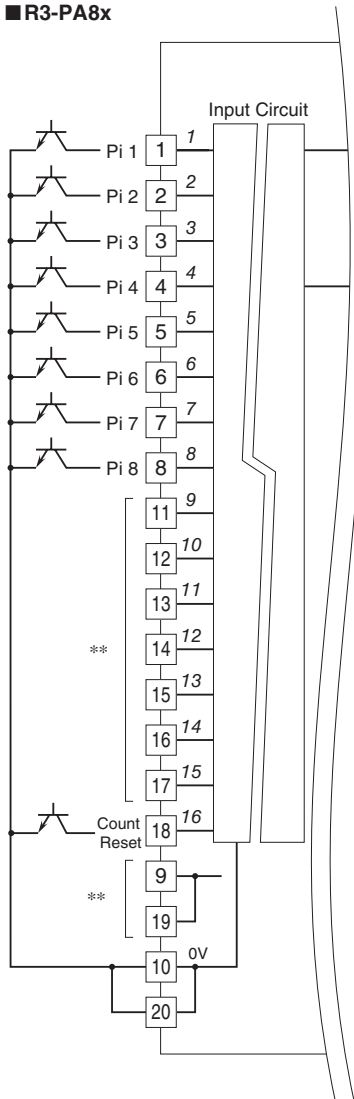

■ R3-PA8x/A

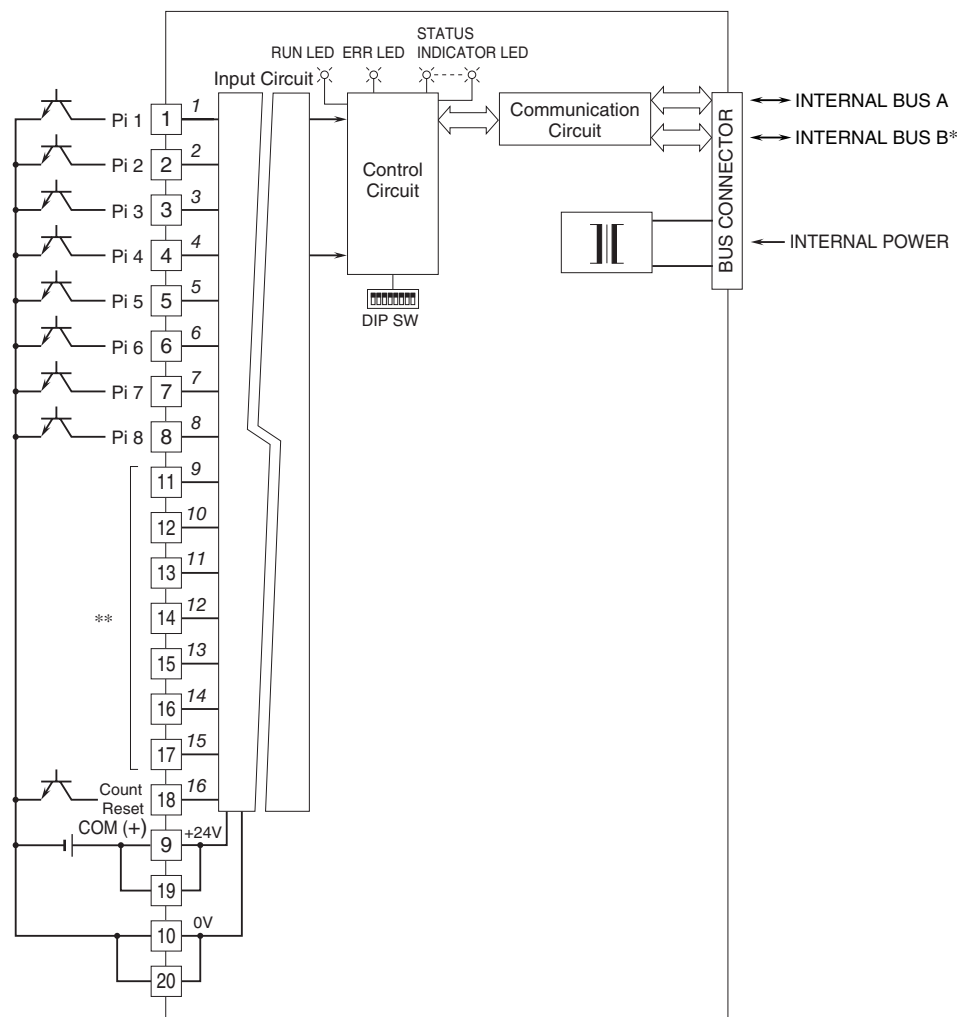

Numbers in italic indicate LED No.s assigned to the front panel LEDs.

*For dual redundant communication.

**DO NOT use the terminals No. 9, 11 through 17 and 19.





Specifications are subject to change without notice.

